



MATERIALS AND COMPACTION TABLE						
PIPE LOCATION	BEDDING ZONE			TRENCH ZONE		
	MATERIAL REQUIREMENT	PLACEMENT REQUIREMENT	COMPACTION REQUIREMENT	MATERIAL REQUIREMENT	PLACEMENT REQUIREMENT	COMPACTION REQUIREMENT
INSIDE ROADWAY PRISM	COARSE AGGREGATE FOR CONCRETE SIZE NO. 1, NO. 2A, OR NO. 2B (SUBSECTION 703.02)	SECTION 210	ENGINEER ACCEPTANCE	3/4" AGGREGATE FOR BASE (SUBSECTION 703.04) (SEE NOTE NO. 1)	SECTION 210	CLASS A COMPACTION (SECTION 205)
OUTSIDE ROADWAY PRISM	COARSE AGGREGATE FOR CONCRETE SIZE NO. 1, NO. 2A, OR NO. 2B (SUBSECTION 703.02)	SECTION 210	ENGINEER ACCEPTANCE	GRANULAR BORROW OR NATIVE MATERIALS WITH MAXIMUM SIZE OF 6" AND FREE FROM WOOD WASTE OR DELETERIOUS MATERIALS. (SEE NOTE NO. 1)	SECTION 210	CLASS D COMPACTION (SECTION 205)

MINIMUM DIMENSION TABLE (SEE NOTE NOS. 3 AND 4)		
D (INCHES)	B (INCHES)	S (INCHES)
≤ 6	10	24
7 TO 15	12	24
16 TO 30	18	24
> 30	24	GREATER OF 24 OR D/2

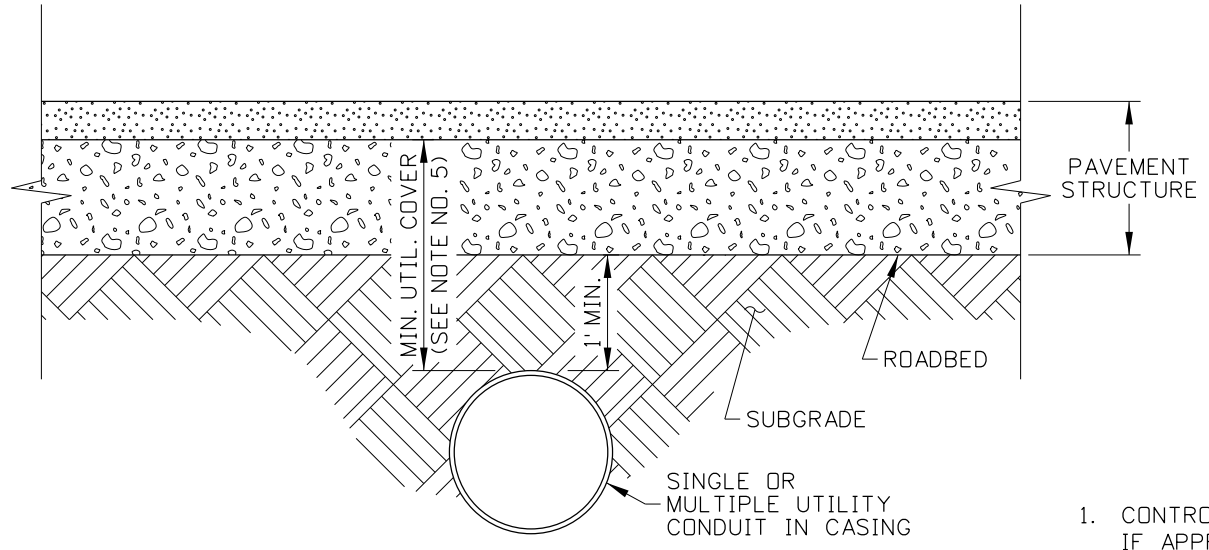

JACKING, DRIVING, OR BORING

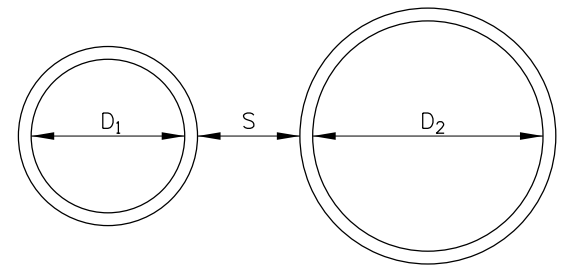


MULTIPLE PIPE INSTALLATION DETAIL

NOTES

- CONTROLLED DENSITY FILL (CDF) PER SECTION 522 CAN BE USED IF APPROVED BY THE ENGINEER.
- LOOSE LIFT THICKNESS DIRECTLY ON TOP OF PIPE MAY BE INCREASED WITH APPROVAL TO PREVENT DAMAGE TO PIPE DURING COMPACTION.
- WHEN TWO DIFFERENT DIAMETER PIPES ARE INSTALLED, USE THE LARGER D DIMENSION TO DETERMINE THE S DIMENSION.
- FOR PIPE DIAMETERS GREATER THAN 36 INCHES, THE B DIMENSION SHOULD BE EQUAL TO THE PIPE DIAMETER WHEN THE PIPE IS INSTALLED DURING EMBANKMENT CONSTRUCTION.
- MINIMUM DEPTH OF COVER FOR CONDUITS CARRYING:
 WATER: 4'
 LIQUID OR GAS PETROLEUM: 4'
 ELECTRICAL MAIN LINE: 4'
 COMMUNICATIONS OR ELECTRONICS: 2'
 UTILITY OWNERS AND LOCAL PUBLIC AGENCIES MAY HAVE DIFFERENT MINIMUM COVER DEPTHS. CONTRACTOR IS RESPONSIBLE FOR VERIFYING THE REQUIRED COVER DEPTHS.
- PERFORM TRENCHING PER OSHA REQUIREMENTS.
- DRAWINGS NOT TO SCALE.

ORIGINAL STORED AT: ITD, Headquarters 3311 West State Boise, Idaho

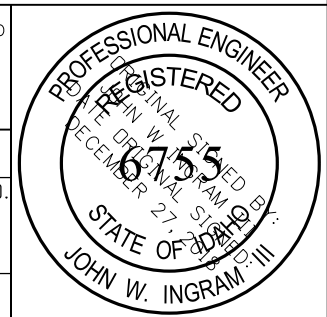

REVISIONS								
NO.	DATE	BY	NO.	DATE	BY	NO.	DATE	BY
1	12-15	RDL						
2	03-16	RDL						
3	06-17	RDL						
4	06-18	HEB						
5	11-18	TWF						

SCALES SHOWN ARE FOR 11" X 17" PRINTS ONLY
 CADD FILE NAME: 601-1_1218.dgn
 DRAWING DATE: MAY 2014

IDAHO TRANSPORTATION DEPARTMENT
 BOISE IDAHO

ORIGINAL SIGNED BY: KEVIN SABLAN
 DESIGN/TRAFFIC SERVICES ENGINEER

STANDARD DRAWING
PIPE AND CONDUIT INSTALLATION

English
 STANDARD DRAWING NO. 601-1
 SHEET 1 OF 1