




DETECTABLE WARNING SURFACES (SEE NOTE NO. 8) DETECTABLE WARNING SURFACES (SEE NOTE NO. 8) DETECTABLE WARNING SURFACES (SEE NOTE NO. 8)

SYMBOL LEGEND


← 5.0% TO 8.3% RUNNING SLOPE, 2.0% OR FLATTER CROSS SLOPE

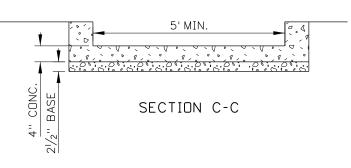





SEE NOTE NO. 6





VERTICAL DISCONTINUITY BETWEEN 1/4" AND 1/2"

PEDESTRIAN REFUGE ISLAND DETAILS

VERTICAL SURFACE DISCONTINUITY DETAIL
SEE NOTE NO. 5

NOTES

- 1. SIDEWALKS MAY CONSIST OF A PEDESTRIAN CIRCULATION PATH AND A PEDESTRIAN ACCESS ROUTE. THE PEDESTRIAN CIRCULATION PATH IS A PREPARED SURFACE PROVIDED FOR PEDESTRIAN TRAVEL IN THE PUBLIC RIGHT-OF-WAY. THE PEDESTRIAN ACCESS ROUTE IS A CONTINUOUS AND UNOBSTRUCTED PATH OF TRAVEL PROVIDED FOR PEDESTRIANS WITH DISABILITIES WITHIN OR COINCIDING WITH A PEDESTRIAN CIRCULATION PATH
- 2. PROVIDE AT LEAST 4'OF CONTINUOUS CLEAR WIDTH OF PEDESTRIAN ACCESS ROUTE, EXCLUSIVE OF THE CURB WIDTH. WHERE SIDEWALKS ARE WIDER THAN 4', ONLY A PORTION OF THE SIDEWALK IS REQUIRED TO BE PART OF THE PEDESTRIAN ACCESS ROUTE.

PROVIDE A PASSING SPACE AT 200'OR SHORTER INTERVALS WHEN THE CLEAR WIDTH OF THE PEDESTRIAN ACCESS ROUTE IS LESS THAN 5'. ENSURE THAT THE DIMENSIONS OF THE PASSING SPACE ARE AT LEAST 5' BY 5'. INTERSECTING SIDEWALKS, DRIVEWAYS, AND ALLEYS MAY BE USED AS PASSING SPACES.

- 3. ENSURE THAT THE GRADE OF THE PEDESTRIAN ACCESS ROUTE DOES NOT EXCEED THE GENERAL GRADE ESTABLISHED FOR THE ADJACENT HIGHWAY.
- 4. ENSURE THAT THE CROSS SLOPE OF THE PEDESTRIAN ACCESS ROUTE WITHIN THE SIDEWALK DOES NOT EXCEED TWO PERCENT.
- 5. VERTICAL SURFACE DISCONTINUITIES MAY OCCASIONALLY OCCUR AT EXPANSION JOINTS, UTILITY COVERS, VAULT FRAMES, AND GRATINGS WITHIN THE SIDEWALK. ENSURE THAT VERTICAL SURFACE DISCONTINUITIES DO NOT EXCEED 1/2". BEVEL VERTICAL SURFACE DISCONTINUITIES BETWEEN 1/4" AND 1/2" WITH A 2:1 SLOPE ACROSS THE ENTIRE VERTICAL SURFACE DISCONTINUITY.
- 6. ENSURE THAT HORIZONTAL OPENINGS IN GRATINGS AND JOINTS DO NOT PERMIT PASSAGE OF A SPHERE MORE THAN $\frac{1}{2}$ " IN DIAMETER.
- 7. OBJECTS PROTRUDING INTO OR OVERHANGING A PEDESTRIAN CIRCULATION PATH MUST NOT REDUCE THE MINIMUM CLEAR WIDTH OF THE PEDESTRIAN ACCESS ROUTE. PROTRUDING OBJECTS INCLUDE STREET FURNITURE, STREET LIGHTS, UTILITY POLES, EQUIPMENT CABINETS, SIGN POSTS AND SIGNS, PARKING METERS, TRASH RECEPTACLES, PUBLIC TELEPHONES, MAILBOXES, NEWSPAPER VENDING MACHINES, BENCHES, TRANSIT SHELTERS, KIOSKS, BICYCLE RACKS, PLANTERS AND PLANTED TREES, AND STREET SCULPTURES. ENSURE THAT OBJECTS WITH LEADING EDGES BETWEEN 2'-3" AND 6'-8" ABOVE THE FINISH SURFACE DO NOT PROTRUDE MORE THAN 4"
- 8. PROVIDE DETECTABLE WARNING SURFACES ON PEDESTRIAN REFUGE ISLANDS WITH CURB RAMPS OR WHEN CUT-THROUGH AT STREET LEVEL AND REFUGE ISLAND WIDTHS ARE GREATER THAN SIX FEET IN THE DIRECTION OF PEDESTRIAN TRAVEL. DO NOT INSTALL DETECTABLE WARNING SURFACES AT PEDESTRIAN REFUGE ISLANDS THAT ARE CUT-THROUGH AT STREET LEVEL AND ARE LESS THAN SIX FEET IN WIDTH IN THE DIRECTION OF PEDESTRIAN TRAVEL. SEE STANDARD DRAWING 614-3 FOR DETECTABLE
- 9. USE A BOND PREVENTATIVE BETWEEN THE SIDEWALK AND CURB WHEN CONSTRUCTED SEPARATELY AND PLACED ADJACENT TO EACH OTHER.

HORIZONTALLY INTO THE PEDESTRIAN CIRCULATION PATH.

- 10. ALIGN CURB AND SIDEWALK JOINTS. CONSTRUCT JOINTS AT 5'INTERVALS THAT ARE APPROXIMATELY 1/8'' WIDE AND 3/4'' IN DEPTH. CONSTRUCT A LONGITUDINAL JOINT WHEN THE SIDEWALK IS 8'WIDE OR WIDER. INSTALL A PREFORMED EXPANSION JOINT FILLER EVERY 40'.
- 11. DRAWING NOT TO SCALE.

WARNING SURFACE DETAILS.

STANDARD DRAWING

SIDEWALKS

English
standard drawing no

614-1

DRIGINAL STORE[AT: ITD, Headquarters 3311 West State Boise, Idaho

SHEET 2 OF 2

REVISIONS									SCALES SHOWN
NO.	DATE	BY	NO.	DATE	BY	NO.	DATE	BY	ARE FOR 11" X 17"
									PRINTS ONLY
									CADD FILE NAME: 614-1_0615.dgn
									DRAWING DATE: MAY, 2015

DETECTABLE

WARNING SURFACES

(SEE NOTE NO. 8)

IDAHO
TRANSPORTATION
DEPARTMENT
BOISE IDAHO

ORIGINAL SIGNED BY: KEVIN SABLAN
DESIGN/TRAFFIC SERVICES ENGINEER

2

